

PANEL P1
120/208V
1-PHASE 3-WIRE

NEW PANEL - SURFACE MOUNTED

PANEL NO.	PANEL P1	VOLTAGE	120/240 1-PHASE 3-WIRE	BUS AMPS	400	MCB	22K	AIC			
FEEDER	(3)50MCMH100	CONDUIT SIZE	3" RISER CONDUIT								
CCT. NO.	BKR. AMPS	LOAD SERVED	PHASE	A	B	PHASE	A	B	LOAD SERVED	BKR. AMPS	CCT. NO.
1	20	R-CLERK 001		.90					LRMS 001 002	20	2
3	20	R-JUDGE 002		1.10					LRMS 004 005 006	20	4
5	20	R-MEETING 004		1.26					LRMS 008 009 010 011 021	20	6
7	20	R-COURT ROOM 004		9					LRMS 022-025	20	8
9	20	R-CONFERENCE ROOM 006		.72					EXTERIOR LTS.	20	10
11	20	R-CONFERENCE ROOM 006		1.50					REXTERIOR (ENTRY 2)	20	12
13	20	R-CONFERENCE ROOM 006		1.50					SPACE	20	14
15	20	R-SHERIFFS OFFICE 005		.72					SPACE	20	16
17	20	R-TOWN CLERK 009		1.08					ACCU 4	25/2	18
19	20	R-CEO, ZEO CLERK 009		1.08					ACCU 3	30/2	20
21	20	R-CEO, ZEO CLERK 009		1.08					ACCU 3	30/2	22
23	20	R-SUPPLIES & COPIES 019		1.50					ACCU 2	20/2	24
25	20	R-SUPERVISOR/BKBRK 025		1.08					ACCU 2	20/2	26
27	20	R-TAX COLLECTOR 023		.90					ACCU 4	25/2	28
29	20	R-ASSESSOR & ASST 022		1.26					ACCU 4	25/2	30
31	20	R-IT CLOSET		1.50					ACCU 4	25/2	32
33	20	R-ENTRY 2, 011		.25					GARAGE	100/2	34
35	20	R-ENT 2, CORRS. 010, 015, 021		.72					PANEL P2	200/2	36
37	20	R-COVERED ENTRY 012		.18					SPACE	20	38
39	20	R-EXTERIOR (ENTRY 1)		.30					SPACE	20	40
41	20	SPACE							SPACE	20	42
TOTAL				9.31	9.28						

NOTES:
1. TURN ALL SPARE CIRCUIT BREAKERS IN THE OFF POSITION WITHIN THE ABOVE PANEL.
2. PROVIDE TIMELOCK TO CONTROL EXTERIOR LIGHTS TORX MODEL REV1018 SERIES OR EQUAL.


PANEL P2
120/208V
3-WIRE

NEW PANEL - SURFACE MOUNTED

PANEL NO.	PANEL P2	VOLTAGE	120/240 1-PHASE 3-WIRE	BUS AMPS	200	MLO	22K	AIC			
FEEDER	(3)350MCMH100	CONDUIT SIZE	2"								
CCT. NO.	BKR. AMPS	LOAD SERVED	PHASE	A	B	PHASE	A	B	LOAD SERVED	BKR. AMPS	CCT. NO.
1	20	EMH-1		3.0					EMH-3	20	2
3	20	EMH-2		3.0					R-2ND FL.	20	4
5	20	R-BAITRMS		1.08					R-2ND FL.	20	6
7	20	R-BAITRMS		.83					ACCU 1	25/2	8
9	16/2	AHU-1		.83					RANGE	40/2	10
11	16/2	AHU-2		.83					MICROWAVE	20/1	14
13	16/2	AHU-3		.83					1.5	20/1	16
15	16/2	AHU-3		.83					1.0	20/1	18
17	16/2	AHU-4		.83					SECURITY PANEL	20	22
21	16/2	AHU-4		.83					FURNACE	20	24
23	16/2	MAU-1		1.8					SPACE	20	26
27	20	SPACE							SPACE	20	28
29	20	SPACE							SPACE	20	30
31	20	SPACE							SPACE	20	32
33	20	SPACE							SPACE	20	34
35	20	SPACE							SPACE	20	36
37	20	SPACE							SPACE	20	38
39	20	SPACE							SPACE	20	40
TOTAL											


NOTES:
1. TURN ALL SPARE CIRCUIT BREAKERS IN THE OFF POSITION WITHIN THE ABOVE PANEL.
2. PROVIDE TIMELOCK TO CONTROL EXTERIOR LIGHTS TORX MODEL REV1018 SERIES OR EQUAL.
AND ADD TO THIS PANEL.

1 PANEL SCHEDULES
E3 NTS

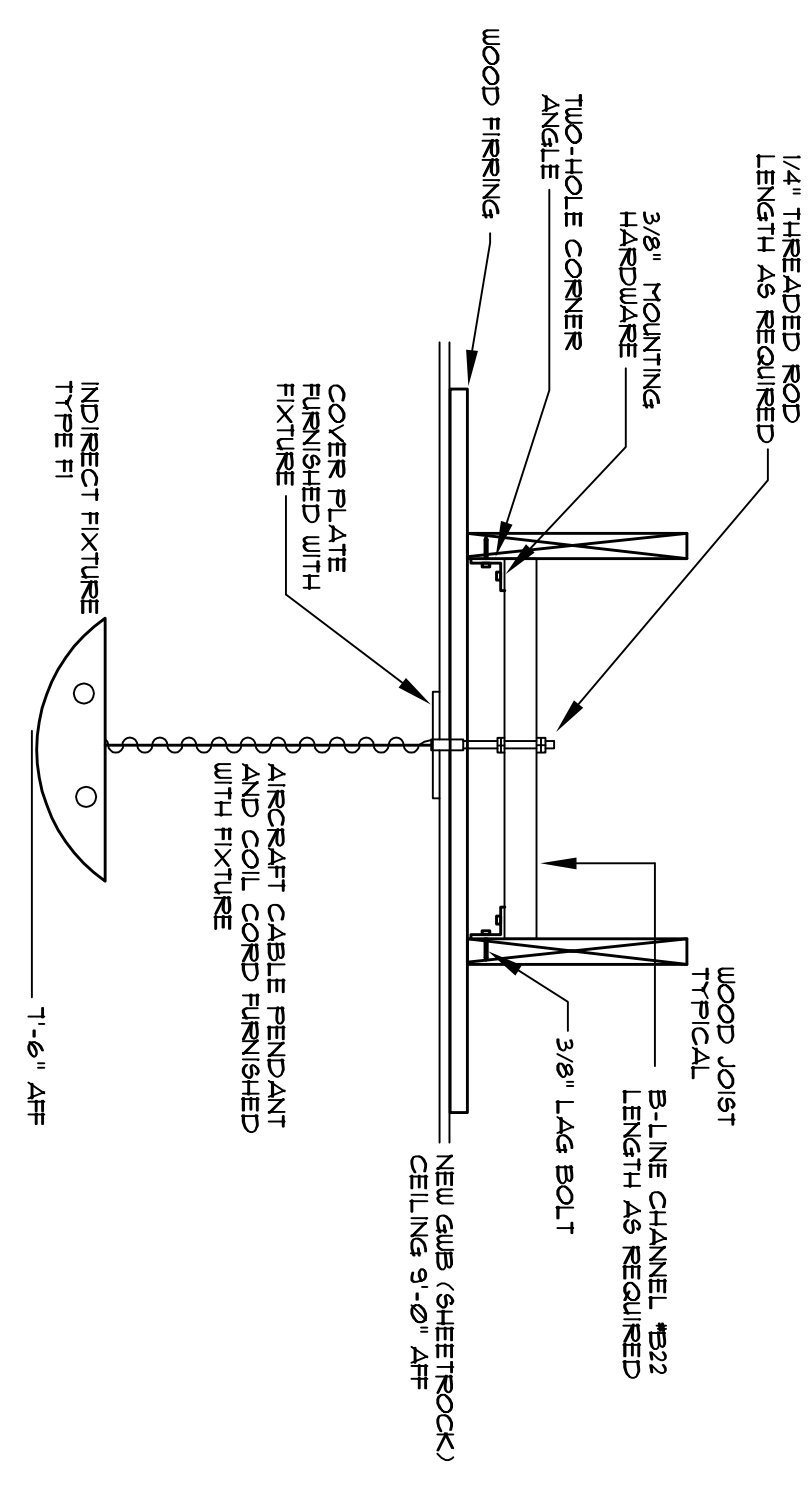


NOTE:
1. INSTALL FIXTURES LEVEL AND STRAIGHT.

2 FIXTURE F9 SUSPENSION DETAIL
E3 NTS

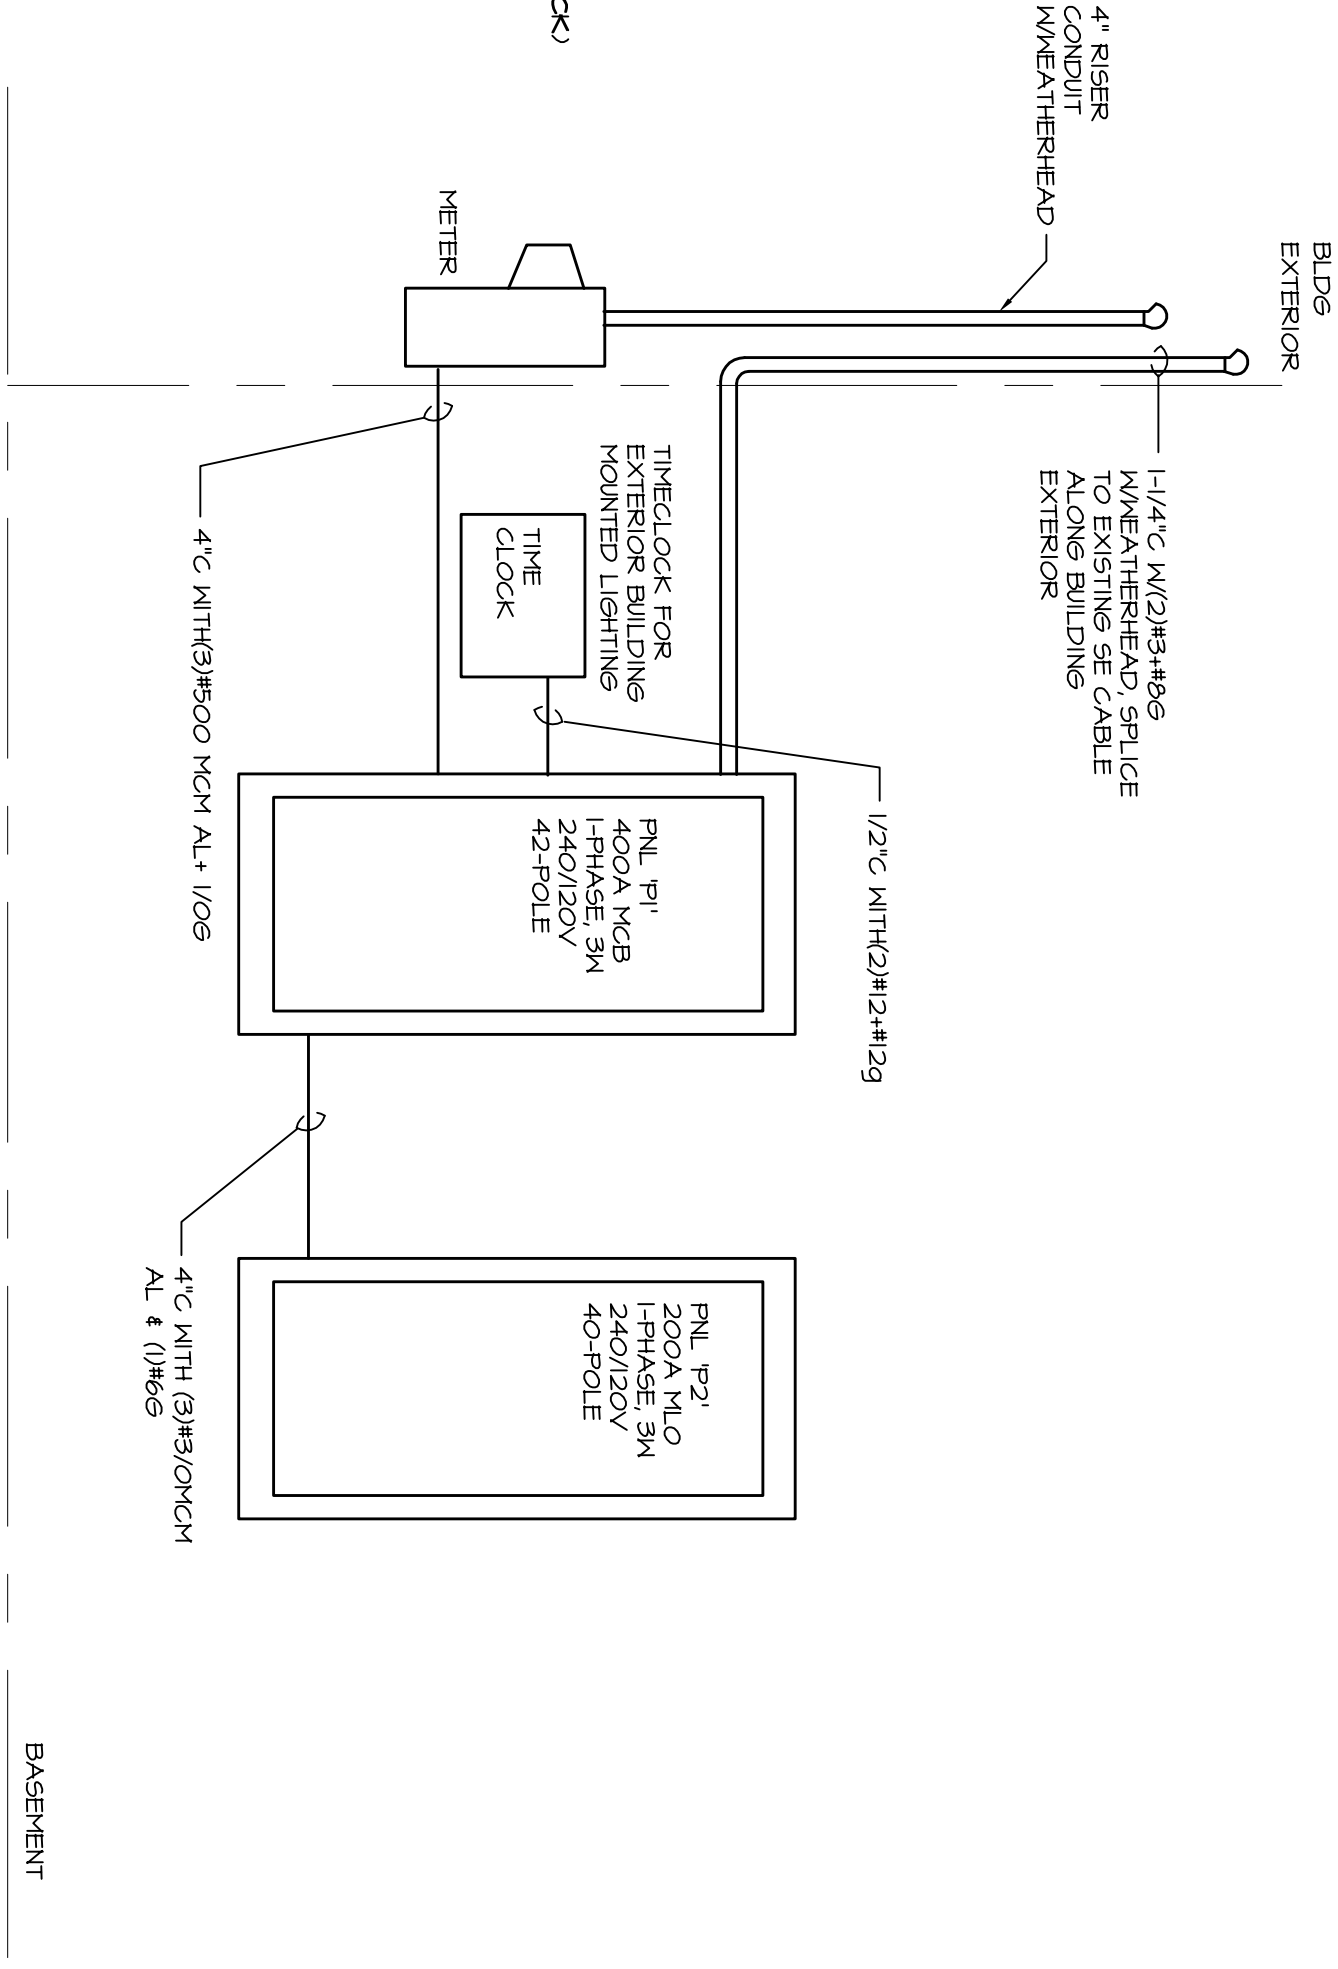


4 ONE LINE DIAGRAM
E3 NTS

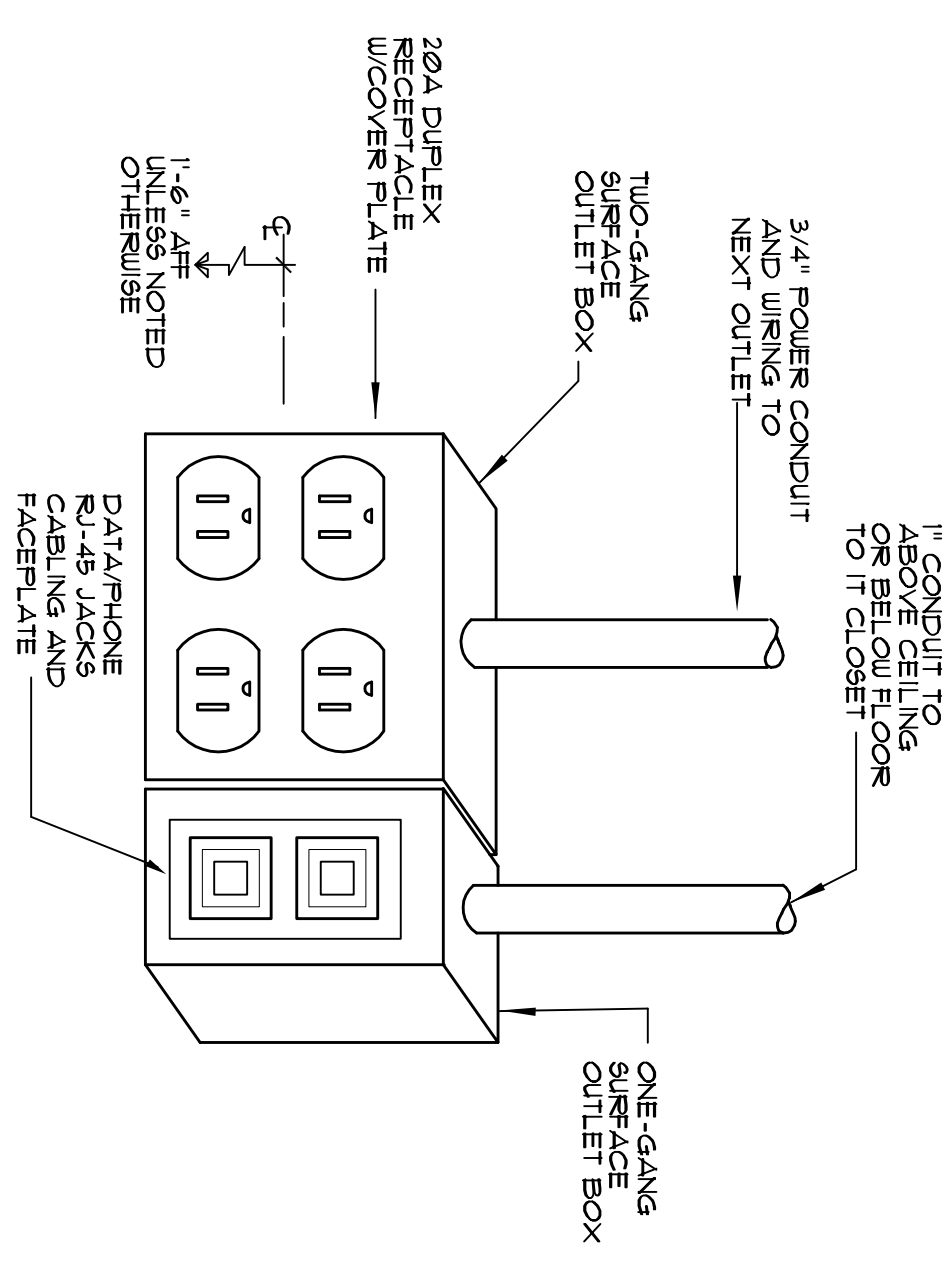

NOTE:
1. DATA CABLING SHALL BE CAT 6 RATED INDIVIDUALLY RUN FROM EACH JACK TO IT DATA CLOSET ON FIRST FLOOR

3 SINGLE STATION COMPUTER OUTLET DETAIL - SURFACE MOUNTED
E3 NTS

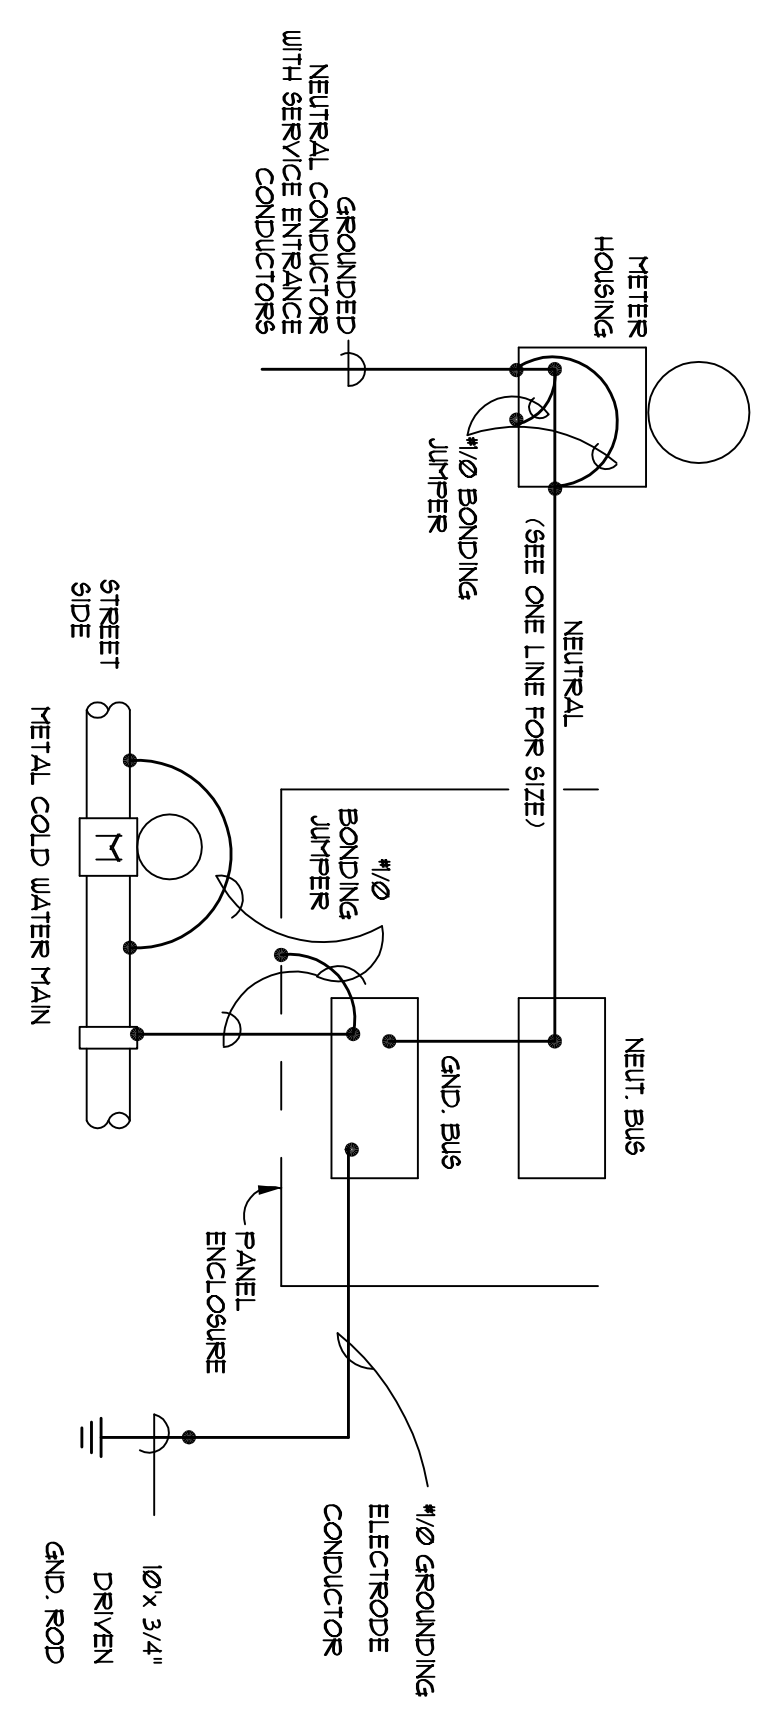

5 SERVICE GROUNDING DETAIL
E3 NTS

ARCHITECTURAL BUREAU
JOE IUVIENE AIA
P.O. BOX 238 - 29 MAIN STREET
CHATHAM NEW YORK 12037
(518) - 392 - 3650

PLUMB EXCEL GROUP
ENGINEERING, P.C.
29 British American Boulevard
Latham, New York 12110
PHONE: 518.464.0412 FAX: 518.464.0834

ADDITIONS RECONFIGURATION
AND RENOVATION
NEW LEBANON TOWN HALL
14755 Route 22
NEW LEBANON NY

ELECTRICAL
PANEL SCHEDULES

REVISIONS

SCALE: NONE
DRAWN BY: PKR
DESIGNED BY: PKR
CHECKED BY: JM

9/08/10

E3